


TOP MULTI 2 TEST REPORT ISO 20361

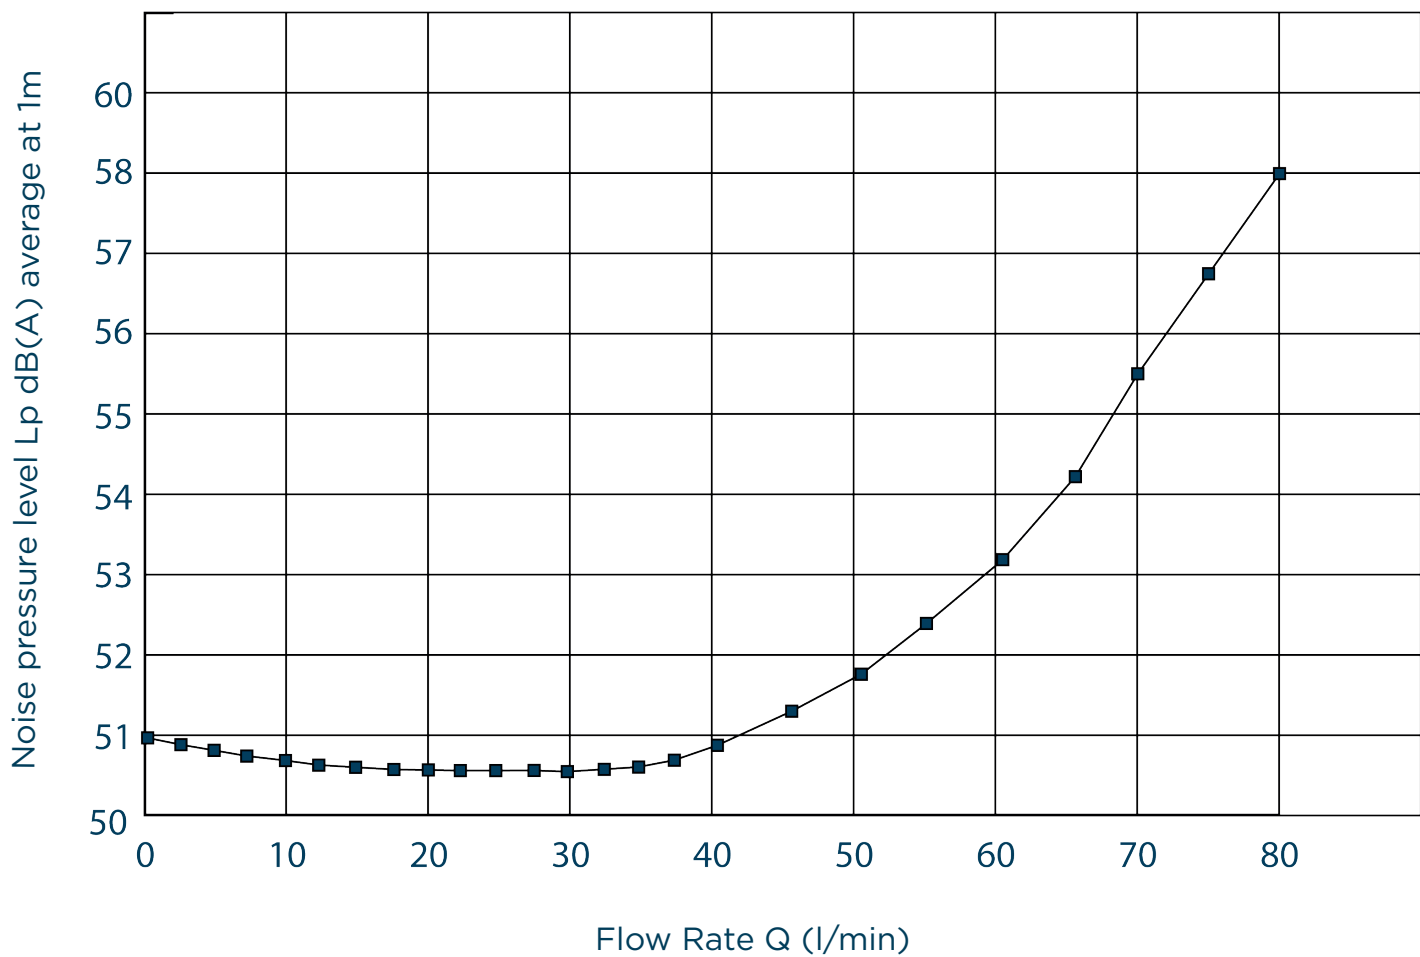

The performances were carried out with the water level just above the strainer and the pump suspended.

Please note, when a pump is submerged in liquid, you are no longer dealing with decibel levels, but vibration levels, so the positioning of your Multiboost is vitally important.

The subsequent vibration levels will vary depending on the amount of space surrounding the unit and the type of material it is placed on. The use of insulation jackets will help to reduce vibration noise.

